# NOVOS 3 x (EPD) RS485 Modbus

Room operating unit temperature, optional with humidity | CO2 | VOC



# Datasheet

Subject to technical alteration Issue date: 15.05.2024 • A141





# » APPLICATION

Room operating unit with recording room temperature, optional with humidity, CO2 or VOC. The maintenance-free sensor creates the conditions for a pleasant indoor climate and well-being. Typical applications are schools, office buildings, hotels, cinemas or similar.

#### » TYPES AVAILABLE

#### Room operating unit temperature - active RS485 Modbus

NOVOS 3 P\*



NOVOS 3 TD\*

**NOVOS 3 PTD\*** 



\*optional available with ePaper display

# » SECURITY ADVICE – CAUTION

The installation and assembly of electrical equipment should only be performed by authorized personnel.



The product should only be used for the intended application. Unauthorised modifications are prohibited! The product must not be used in relation with any equipment that in case of a failure may threaten, directly or indirectly, human health or life or result in danger to human beings, animals or assets. Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Please comply with

- Local laws, health & safety regulations, technical standards and regulations
- Condition of the device at the time of installation, to ensure safe installation
- This data sheet and installation manual

# » BUILD-UP OF SELF-HEATING BY ELECTRICAL DISSIPATIVE POWER

Sensors with electronic components always have a dissipative power, which affects the temperature measurement of the ambient air. The dissipation in active temperature sensors shows a linear increase with rising operating voltage. This dissipative power has to be considered when measuring temperature. In case of a fixed operating voltage  $(\pm 0, 2 \text{ V})$  this is normally done by adding or reducing a constant offset value.

Thermokon transducers can be operated with variable operating voltages. The transducers are set at the factory with a reference operating voltage of 24 V =.

At this voltage, the expected measuring error of the output signal will be the least. Other operating voltages, can cause a measurement deviation changing power loss of the sensor electronics.

A recalibration can be carried out directly on the unit or via a software variable (app or bus).

Remark: Occurring draught leads to a better carrying-off of dissipative power at the sensor. Thus temporally limited fluctuations might occur upon temperature measurement.

# »APPLICATION NOTICE FOR HUMIDITY SENSORS

At regular environmental condition, it is recommended to calibrate the sensor annually to check the compliance with the accuracy required in the application. The following conditions can damage the sensor element or lead in long therm to loss of the specified accuracy:

- Mechanical stress
- Contamination (e.g. dust / fingerprints)
- Aggressive chemicals
- Ambient conditions (e.g. condensation on measuring element)

Re-calibration or exchange of the sensor element are not subject of the general warranty.

### »INFORMATION ABOUT SELF-CALIBRATION FEATURE CO2

All gas sensors are subject to drift. The degree of drift is dependent on the use of components and product design. In addition, the following environmental conditions, among others, can accelerate/ favor the aging and wear of the sensors:

- Mechanical stress (also due to temperature fluctuation)
- Contamination (dust / fingerprints e.g.)
- Abrasive chemicals
- Environmental influences (high humidity / condensation on measuring element)

An internal self calibration function with dual channel technology compensates the caused drift. Thermokon sensors are for permanent use (e.g. hospitals).

### » INFORMATION ABOUT INDOOR AIR QUALITY CO2

EN 13779 defines several classes for indoor air quality:

Category	CO <sub>2</sub> content above the content	in outdoor air in ppm	Description
	Typical range	Standard value	
IDA1	<400 ppm	350 ppm	Good indoor air quality
IDA2	400 600 ppm	500 ppm	Standard indoor air quality
IDA3	6001.000 ppm	800 ppm	Moderate indoor air quality
IDA4	>1.000 ppm	1.200 ppm	Poor indoor air quality

# » APPLICATION NOTICE FOR AIR QUALITY SENSORS VOC

Volatile organic compunds (VOC) are gaseous and vaporous substances of organic origin in the air. VOC-sensors monitor the significant part of humanly olfactory sensed air quality. (e.g. body odur | tobacco smoke | odur of materials, furniture, carpets, paint, adhesives, ...)

The VOC-Value is an application-specific indication for air quality and doesn't provide any information about individual components of VOC

A VOC sensor oxidises the organic molecules that collide with it, which results in changing the resistance of the semiconductor.

Any contact with the sensitive sensors must be avoided and will invalidate the warranty.

The VOC Sensor is factory calibrated and can be calibrated via NOVOSapp subsequently, if needed.



Do not touch the sensor elements!

# » TECHNICAL DATA

Measuring values	Temperature   humidity   0	CO2   VOC				
Network technology	RS485 Modbus, RTU, half-duplex, baud rate 9.600, 19.200, 38.400 or 57600, parity: none (1 stopbit, alternative 2 stopbits), even or odd (1 stopbit), Fail-safe Biasing required					
Power supply	1535 V = (or 1929 V ~)	* SELV				
Power consumption	typ. 0,4 W (24 V =)   0,8 V	/A (24 V ~)				
Inputs	1x input for floating input					
Set point (P) (optional)	potentiometer					
Button (T) (optional)	for presence detection, w	ith LED (TD)				
LED (D) (optional)	for status feedback, color BUS	can be set (from 7 colours	) via Thermokon NOVOSa	op (any from RGB) or		
Display (optional)	ePaper, as measured val	ue display, display can be p	parameterized via Thermok	on NOVOSapp		
Enclosure	PC V0, pure white, design	n cover (optional)				
Protection	IP20 according to DIN EN	1 60529				
Cable entry	rear entry, breaking points	s bottom, drill mark top				
Connection electrical	tool-free mountable spring	g terminal, max. AWG16 (1	,5 mm²)			
Ambient condition		max. 85% non-condensing operating temperature range	g, ge +32+122°F (0+50 °C)			
Mounting	surface mounted on flush base part can be mounte		or to be mounted flat onto	the surface using screws,		
» Temperature						
Measuring range temperature	-20+70 °C   -4+158 °F					
Accuracy temperature	±0,5K (typ. at 21 °C   70 °	F)				
» Humidity (optional)						
Measuring range humidity	relative humidty	Enthalpy	absolute humidity	dew point		
(optional configurable)	(default) 0100% rH	085 KJ/kg 037 BTU/lb	050   080 g/m³ 01,5   02,3 g/ft³	0+50   -20+80 °C +32+122   -4+176°F		
	configurable via Thermok	on NOVOSapp or BUS				
Accuracy humidity	±2% between 1090% rH	(typ. at 21 °C   70 °F)				
» CO2 (optional)						
Measuring range CO2	02000 ppm   05000 ppm (configurable via Thermokon NOVOSapp or BUS)					
Accuracy CO2	±50 ppm +3 % of reading (typ. at 21 °C   70 °F, 50% rH, 1015 hPa)					
Calibration	self-calibration dual chan	nel				
Sensor	NDIR (non-dispersive, inf	rared)				
Display (optional)	RGB-LED indicating air q	uality (traffic light function '	TLF')			
» VOC (optional)						

Measuring range VOC	0100 %
Sensor	VOC sensor (heated metal oxide semiconductor)

#### \*Power supply

When several BUS devices are supplied by one 24 V AC voltage supply, it is to be ensured that all "positive" operating voltage input terminals (+) of the field devices are connected with each other and all "negative" operating voltage input terminals (-) (=reference potential) are connected together (in-phase connection of field devices).

In case of reversed polarity at one field device, a supply voltage short-circuit would be caused by that device. The consequential short-circuit current flowing through this field my cause damage to it.

# Therefore, pay attention to correct wiring.

# **»**MOUNTING ADVICES

The Accuracy of the room sensors are influenced by the technical specifications as well as the positioning and the installation type.

#### **During Assembly:**

- Seal mounting box (if present).
- Installation type, air draught, heat source, radiation heat or direct sunlight can affect the measurement.
- Bulding material specific properties of the installation place (brick-, concrete-, partition wall, cavity wall, ...) can affect the measurement.

#### Assembly not recommendet in...


- Air draught (e.g.: close to windows / doors / fans ...)
- Near heating sources,
- Direct sunlight
- Niches / between furniture / ...

Please make sure that the device is de-energized if you want to install it!

The installation can be performed on the flat wall surface or on a flush-mounted box. A representative place should be selected. Sunshine and draft, e.g. in the installation tube should be avoided, so that the measurement result is not falsified. Seal the end of the installation tube.

- For wiring, the upper part of the device must be removed from the base plate. Base plate and upper part are detachably connected to each other by means of locking lugs.
- The mounting of the base plate on the flat wall surface is done with rawplugs and screws.
- Finally, the device is attached to the base plate and fixed with the screw.


#### Housing open / close

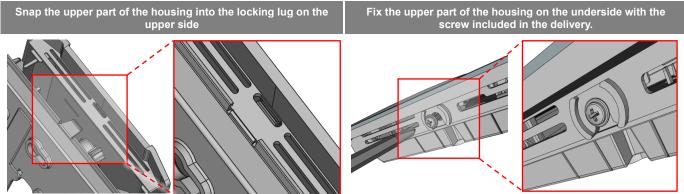



#### Cable entry

There are predetermined breaking points for 2 optional cable entries on the underside of the base plate

On the upper side of the base plate there are 2 grits as position for a drill hole max. Ø 6 mm





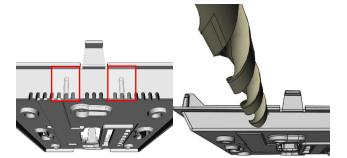



When using a drill, you should absolutely ensure that the base plate is firmly clamped. Before drilling, the pressure must be reduced and carefully drilled. A sudden break-through of the drill bit can be the result.

# »CONNECTION PLAN

#### Room operating unit - active RS485 Modbus

NOVOS 3 RS485 Modbus	With alternating voltage, the correct	
Image: Image	polarity must be ensured! Please note the technical data.	
$ \begin{bmatrix} I & I & I & I & I & I & I & I \\ I - A + & - & - & BUS A & - & - & I & I \\ I - A + & - & - & BUS A & - & - & I \\ I - GND & - & 0 V \\ I - UB + & - & 1535 V = / 1929 V ~ A $	Don´t forget the BUS termination (120 Ω) at the last device of the line! (Not included in delivery)	


# » CONFIGURATION

The configuration is performed in powered state. The following options are available for configuring the device:

Device connection	RS485	Micro-USB	Micro-USB
Configuration- adapter	USB-RS485 Converter	Thermokon USB-Interface	USB-Bluetooth Dongle
			GET IT ON Google Play
Configuration- software	PC/Notebook with uConfig software	PC/Notebook with uConfig software	Smartphone/Tablet with NOVOS App
Soliware	Parameterization via desktop PC/Notebook with uConfig software and a USB/RS485 converter (Item No. 668293)	Parameterization via desktop PC/Notebook with uConfig software, via Thermokon USB- Interface* (Item No. 597838)	Parameterization with mobile devices via Bluetooth and NOVOSapp. A separately available Bluetooth dongle* is required (item no. 668262)

\*Commercially available Bluetooth dongles or USB to Micro-USB adapter cables are not compatible. You need a mobile device that supports at least Bluetooth version 4.1. The configuration app with the corresponding instructions can be downloaded from the Google Play Store or the Apple App Store.


A configuration during operation is additionally via BMS through RS485 connection possible.



Position of the micro USB port, see bottom of the device, for configuration with Bluetooth dongle or Thermokon USB-Interface

# » DISPLAY

The display scales automatically depending on the device and the number of measured variables. Parameters such as the display/hiding of measured variables are changed via the app. The software and hardware versions are displayed during the boot process.

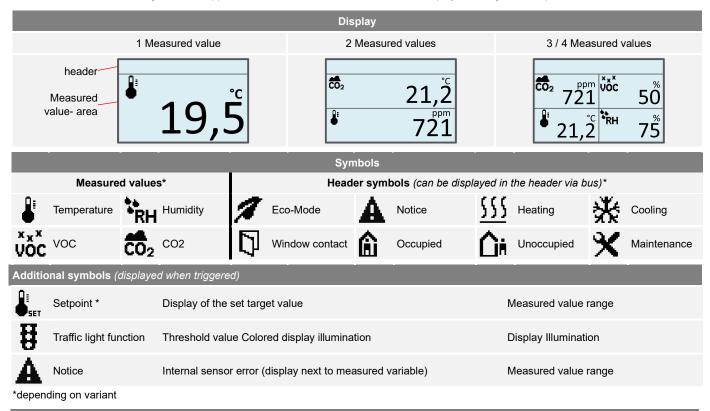

# **»**TLF – TRAFFIC LIGHT FUNCTION (OPTIONAL)

The traffic light function can be implemented with any available measured variable. Different colors can be assigned for up to 5 different measuring ranges.

### Example: CO2 TLF

The LED visualizes the air quality value (Thresholds optionally configurable via Thermocon NOVOSapp).



CO2 (factory default)	Behavior of the LED
0750 ppm	LED lights up in green
7511250 ppm	LED lights up in yellow
12512000 ppm	LED lights up in red

5 = on

2<sup>4</sup> (16)

6 = on

2<sup>5</sup> (32)

# » DIP-SWITCH-SETTINGS

The modbus address of the device is set in the range of 1 ... 63 (binary encoded) using a 6-pole DIP switch. With address 0 via DIP, an extended address range (64..247) is available via NOVOSapp.

# Modbus-Adress - DIP 1..6 (binary coded)

ON			
12	3 4 5 6	78910	

	Value	2º (1)	2 <sup>1</sup> (2)	2² (4)	2 <sup>3</sup> (8)
_					

Dip switch 1 = on 2 = on 3 = on 4 = on

Factory default, adress 63

# Baud rate - DIP 7 & 8

	7	8	Baud rate	
ON	off	off	9600	
	on	off	19200	
1 2 3 4 5 6 7 8 9 10	off	on	38400	
	on	on	57600	(factory default)

# Parity / Stop bits - DIP 9 & 10

	9	10	Parity
ON	off	off	None – 2-Stopbits
	on	off	Even – 1 Stopbit
<u>1</u> <u>2</u> <u>3</u> <u>4</u> <u>5</u> <u>6</u> <u>7</u> <u>8</u> <u>9</u> <u>10</u>	off	on	Odd – 1 Stopbit
	on	on	None – 1-Stopbit (factory default)

### » MODBUS REGISTER

Address	Access	Description		Resolution	/Unit
100	R/W	Button	pressed = 1 Not pressed = 0		
426	R/W	LED ON/OFF	ON = 1 OFF = 0 (default)		
427	R/W	LED color transparent = 0   white = 1   red = 3	green = 4 (default)   blue = 5   yell	ow = 6   magenta = 7   tu	rquoise= 8
501	R	relative humidity	850 = 85,0 %rH	0.1	%rH
505	R	CO2		1.0	ppm
506	R	VOC		0.1	%
507	R	CO2 / VOC MIX			
514	R	Status digital input	open = 0 closed = 1		
1301	R/W	Display temperature setpoint	absolute -> 0 relative -> 1		

### Register 1100 = 1 (Unit SI)

Address	Access	Description	Resolution /Un	Resolution /Unit		
103	R	Setpoint	210 = 21,0 °C	SI	0.1	°C
500	R	Temperature	210 = 21,0 °C	SI	0.1	°C
502	R	Absolute humidity	1500 = 15,00 g/m <sup>3</sup>	SI	0.01	g/m³
503	R	Enthalpy	550 = 55,0 kJ/m <sup>3</sup>	SI	0.1	kJ/kg
504	R	Dew point	180 = 18,0 °C	SI	0.1	°C
1302	R/W	Base set point	210 = 21,0 °C (default)	SI	0.1	°C
1303	R/W	Set point adjustment range	30 = 3,0 °C (default)	SI	0.1	°C
1304	R/W	Setpoint step width	5 = 0,5 °C (default)	SI	0.1	°C

#### Register 1100 = 2 (Unit Imperial)

Address	Access	Description		Resolution / Unit		
103	R	Set point	700 = 70.0 °F	Imperial	0.1	°F
500	R	Temperature	700 = 70,0 °F	Imperial	0.1	°F
502	R	absolute humidity	4200 = 4,2 gr/ft <sup>3</sup>	Imperial	0.01	gr/ft <sup>3</sup>
503	R	Enthalpy	240 = 24,0 BTU/lb	Imperial	0.1	BTU/lb
504	R	dew point	600 = 60,0 °F	Imperial	0.1	°F
1302	R/W	Base setpoint	700 = 70.0 °F (default)	Imperial	0.1	°F
1303	R/W	Setpoint-adjustment range	50 = 5.0 °F (default)	Imperial	0.1	°F
1304	R/W	Setpoint step width	10 = 1.0 °F (default)	Imperial	0.1	°F



Modbus addresses: NOVOS-RS485 Modbus Interface

Download

A detailed description of the Modbus addresses can be found under the following link:

# » PRODUCT TESTING AND CERTIFICATION



#### Declaration of conformity


The declaration of conformity of the products are available on our website <u>https://www.thermokon.de/direct/en-gb/categories/novos-3-x</u>

# » NOTES ON DISPOSAL



The crossed-out wheelie bin symbol indicates that the product or removable batteries must not be disposed of with household or commercial waste. Within the EU, you are legally obliged to dispose of the product separately and appropriately in accordance with the national laws of your country. Alternatively, please contact your supplier or Thermokon Sensortechnik GmbH. Further information can be found at: <a href="http://www.thermokon.com">www.thermokon.com</a>

### » DIMENSIONS (MM)

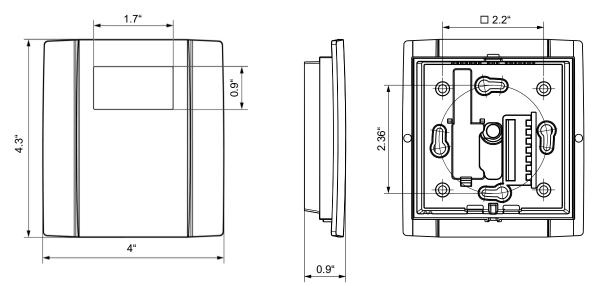

# »ACCESSORIES (OPTIONAL)

Rawlplugs and screws (2 pcs. each) PSU-UP24 – flush mount power supply 24 V (AC Input: 100..240 V ~ | DC Output 24 V = 0,5 A) Mounting bracket (surface mounted) white Mounting bracket (surface mounted) black

Bluetooth dongle Thermokon USB-Interface USB RS485 Modbus RTU Logger USB Interface RS485 (incl. driver CD) RS485 Biasing Adapter Item No. 102209 Item No. 645737 Item No. 795050 Item No. 795074

Item No. 668262 Item No. 597838 Item No. 809917 Item No. 668293 Item No. 811378